

### Enclosures:

**Cast Aluminum:**  
Oven baked powder coating  
hammer tone grey

**Also available in  
SS 316**

Explosion-Proof (IP 66) -  
EN IEC 60529 - Eex-d IIC T6  
(Nema 4X)


**Repeatability:**  
typical 0.2% of Full Scale

**Range & Scale:**  
Standard unit: **Barg**  
Optional: PSI / Kg / Pa

**Standard process connection:**  
1/4" NPT (F) or BSP (F)

**Standard Diaphragm/O-ring:**  
Buna N / Buna N

**For wetted parts:**  
more possibilities available,  
see full catalogue

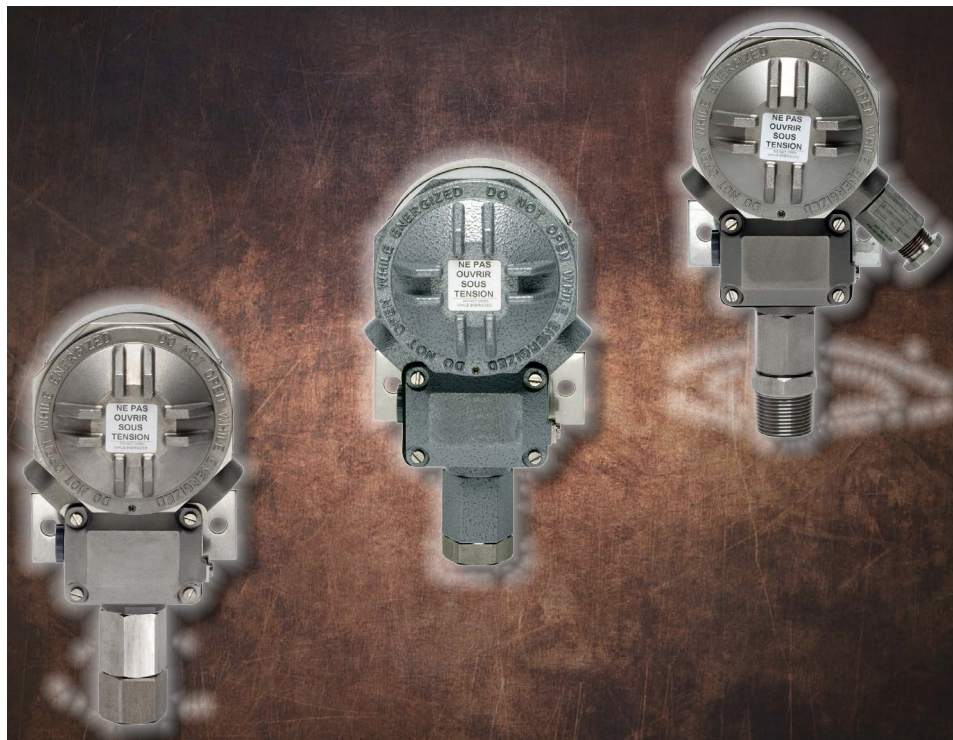

### Ranges for Pressure switches

RANGE CODE	ADJ. RANGE mBar/ Bar	ADJ. RANGE PSI / Inch WC	ADJ. RANGE Kpa/ MPa	ADJ. RANGE Kg/cm2 / mmH2O
P 301 L <sup>1)</sup>	2 - 15 mBar	0.8 - 6 InchWC	0.2 - 1.5 kPa	20 - 150 mmH2O
P 302 L <sup>1)</sup>	10 - 100 mBar	4 - 39 InchWC	1 - 10 kPa	100 - 1000 mmH2O
P 304 L	20 - 240 mBar	8 - 94 InchWC	2 - 24 kPa	200 - 2400 mmH2O
P 306 L	20 - 560 mBar	8 - 220 InchWC	2 - 56 kPa	200 - 5600 mmH2O
P 308 L	25 - 1300 mBar	10 - 510 InchWC	2.5 - 130 kPa	250 - 13000 mmH2O
P 402 M	100 - 400 mBar	1.5 - 5.8 PSI	10 - 40 kPa	0.1 - 0.41 Kg/cm2
P 404 M	100 - 950 mBar	1.5 - 14 PSI	10 - 95 kPa	0.1 - 0.97 Kg/cm2
P 406 M	120 - 2300 mBar	1.7 - 33 PSI	12 - 230 kPa	0.12 - 2.3 Kg/cm2
P 408 M	150 - 5400 mBar	2.1 - 78 PSI	15 - 540 kPa	0.15 - 5.45 Kg/cm2
P 502 H	0.3 - 1.6 Bar	4.4 - 23 PSI	0.03 - 0.16 MPa	0.3 - 1.60 Kg/cm2
P 504 H	0.4 - 3.5 Bar	5.8 - 51 PSI	0.04 - 0.35 MPa	0.4 - 3.5 Kg/cm2
P 506 H	0.5 - 9.0 Bar	7.3 - 130 PSI	0.05 - 0.9 MPa	0.5 - 9.2 Kg/cm2
P 508 H	0.7 - 21.5 Bar	10 - 310 PSI	0.07 - 2.15 MPa	0.7 - 22 Kg/cm2
P 706 H	2.5 - 32 Bar	36 - 464 PSI	0.25 - 3.2 MPa	2.5 - 33 Kg/cm2
P 708 H	3.0 - 76 Bar	44 - 1100 PSI	0.3 - 7.6 MPa	3.1 - 77 Kg/cm2
P 808 H	4.0 - 170 Bar	58 - 2500 PSI	0.4 - 17 MPa	4 - 170 Kg/cm2
P 908 H	10 - 300 Bar	150 - 4400 PSI	1 - 30 MPa	10 - 310 Kg/cm2
P 909 H	10 - 350 Bar	150 - 5100 PSI	1 - 35 MPa	10 - 360 Kg/cm2

<sup>1)</sup> Only available with L1 -microswitch element. K1 possible consult factory).



**Disclaimer:** We reserve the right to make changes or modify the contents of this document without prior notice. RielsInstruments does not accept any liability or claim whatsoever for potential errors, incorrect interpretation or possible lack of information in this document. It is clearly and only intended as coarse and general information of our products.

## Making the modelcode: Follow steps 1 to 5

### 1 Selection of enclosure type.

Conduit	Material	Enclosure code
3/4" NPT F	Aluminium	<b>W3</b>
M20x1.5	SS 316	<b>W8</b>
3/4" NPT F	SS 316	<b>W9</b>

### 2 Selection of range code, see front page.

### 3 Selection of process connection.

Size	Material	Code
1/4"NPT F	Aluminium *	<b>A1N</b>
1/2"NPT F	Aluminium *	<b>A2N</b>
1/4"NPT F	SS316	<b>S1N</b>
1/2"NPT F	SS316	<b>S2N</b>
1/2"NPT M	SS316	<b>S7N</b>

\* Aluminum only, std on P.L. - **Not available** on other ranges.

Above standard process connections are also available in: "**BSP**"

For example: 1/2" BSP F (3316) = **S2B**

Process connections are also available in other materials like, Monel, PVC, Hastelloy, Titanium etc.

### 4 Selection of wetted parts.

Diaphragm	O-ring	* Code
Buna N	Buna N	<b>B1</b>
Viton	Viton	<b>V2</b>
SS316	Buna N	<b>S1</b>
SS316	Viton	<b>S2</b>
SS316	Neoprene	<b>S3</b>
SS316	Teflon	<b>S4</b>
SS316	Welded	<b>S0</b>

#### \* WETTED PARTS ARE NOT GUARANTEED,

against corrosion or permeation since processes vary from plant to plant and concentration of harmful fluids, gasses or solids vary from time to time in a given process. Empirical experience by users should be the final guide and alternate materials based on this are generally available. The diaphragm / O-Ring combinations are for process temperatures of -5°C to +90°C, unless otherwise indicated. For process temperatures beyond these limits please contact your Riels@Instruments Switch Representative

### Accessories:


2" Pipe mount bracket set available.

#### Contents :

2 x Bracket +  
2 x bolts M8 x 100 mm + nut

#### Disclaimer :

This pipe mount bracket is solely intended for use in combination with Riels@Instruments Pressure & Temperature Switches. Foundation vibrations, as well as process vibrations, can disturb the proper functioning of the mounted instrument, the use of this bracket does not prevent or diminishes such occurrence.

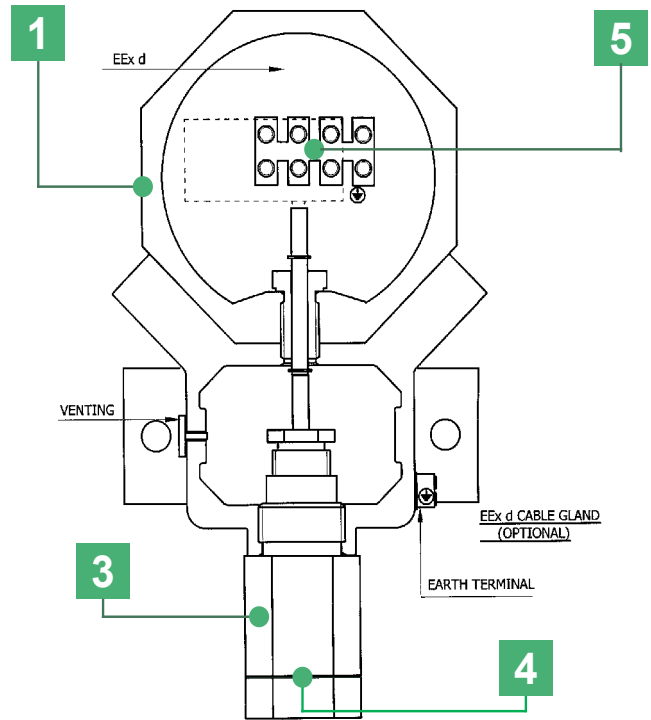

### 5 Selection of microswitches.

Rating:		Use:	Switch Code
VAC.	VDC. <sup>3)</sup>		
480/ 15A	28/ 0.5A	<b>Standard</b>	<b>K1</b> <sup>2)</sup>
480/ 10A	28/ 0.5A	Standaard for L-serie	<b>L1</b> <sup>2)</sup>
480/ 15A	125/ 0.5A	Normal DC-service	<b>U1</b> <sup>2)</sup>
125/ 1A	28/ 0.5A	For use in H <sub>2</sub> S environment <sup>3)</sup> and/or for (EEx)i applications.	<b>G1</b> <b>**</b>
250/ 0.1A	30/ 0.1A		<b>Y1</b> <sup>1)</sup>
250/ 0.1A	30/ 0.1A	Environmental proof (IP 67)	<b>O1</b> <sup>1)</sup>
250/ 2A	30/ 2A		<b>N1</b> <sup>1)</sup>

1) For D.P.D.T action, second code figure should be specified as "2"

For example: **Y1** = S.P.D.T./ **Y2** = D.P.D.T

2) VDE certified acc. to DIN EN 61 058-1:1992+A1:1993.

3) Indicated ratings are for resistive DC load only.

\*\* DC Rating not U.L. listed, although experience and third party testing confirm the D.C Voltage ratings. Consult your local Riels@Instruments switch Representative.

### 6 Selection of options.

Description	Option code
Cable gland	<b>C</b>
Vacuum Protection Plate	<b>M</b>
Stainless steel tag key ringed to enclosure (Tag has 2 lines - 16 charaters per line)	<b>S</b>